


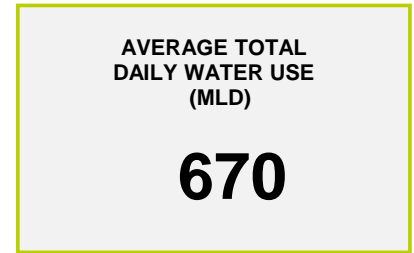
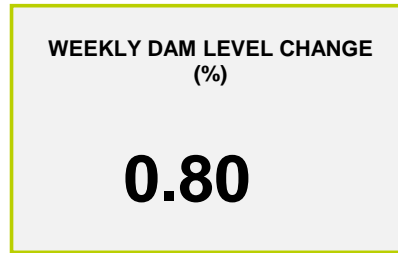


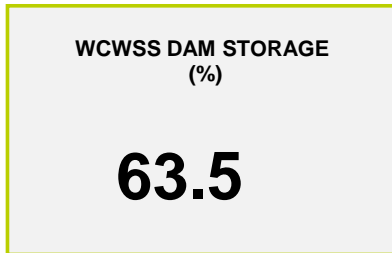


Headline Statistics

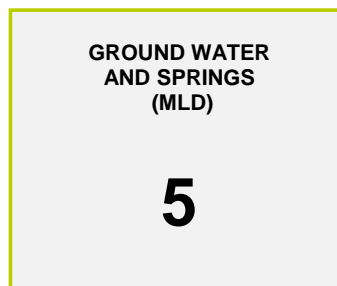

Water Production from Different Sources

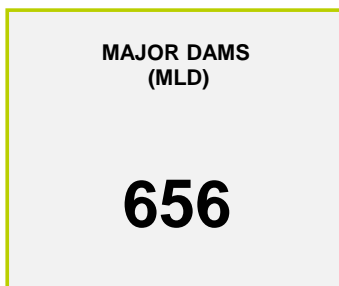

Overall Water Usage Trend (2010 - Present)

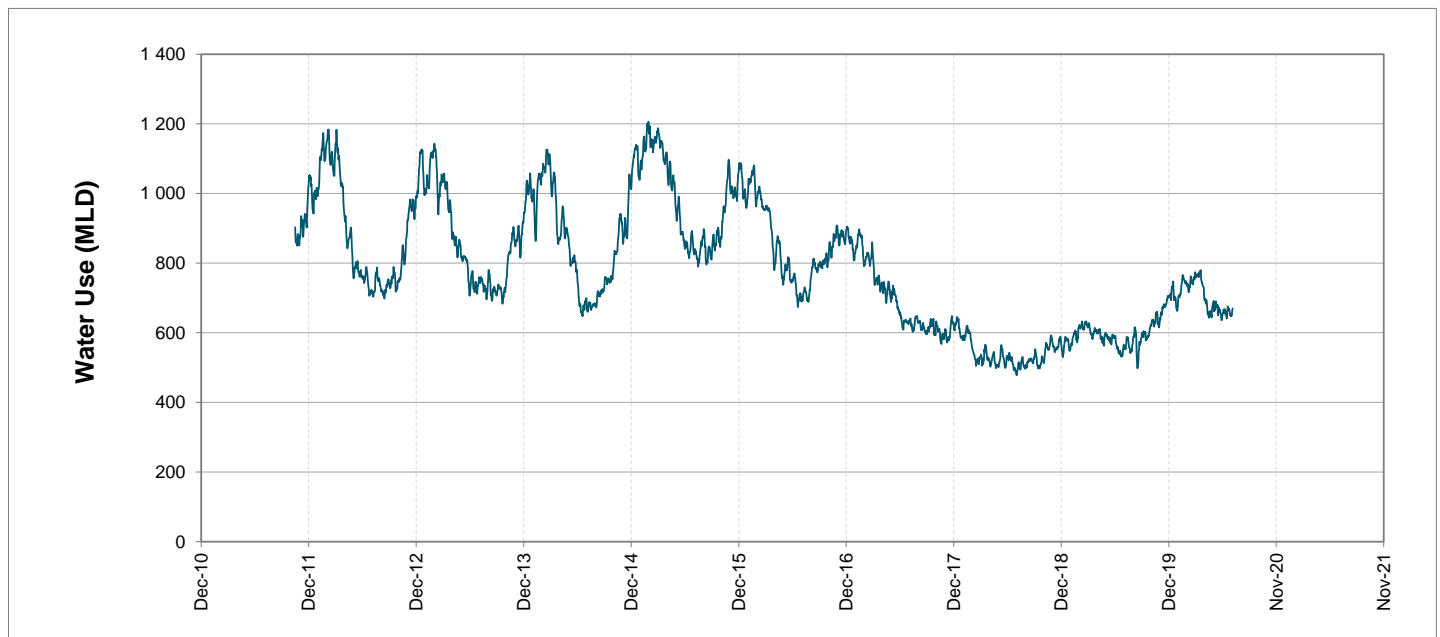

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **63.5%**


Weekly Change **0.8%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	06 July 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	82.4	81.7	87.2	82.2	36.9	44.8
STEENBRAS LOWER	33 517	56.6	51.0	50.4	55.8	28.8	41.9
STEENBRAS UPPER	31 767	99.7	100.7	74.2	99.1	65.6	81.2
THEEWATERSKLOOF	480 188	59.7	59.7	49.2	38.5	19.6	38.2
VOËLVLEI	164 095	58.9	56.1	63.3	49.1	20.1	34.4
WEMMERSHOEK	58 644	50.6	49.6	49.7	82.7	36.1	56.8
TOTAL STORED	898 221	570 612	563 058	523 101	470 862	226 605	371 435
% STORAGE		63.5%	62.7%	58.2%	52.4%	25.2%	41.4%




WCWSS Storage Record (2008 - Present)

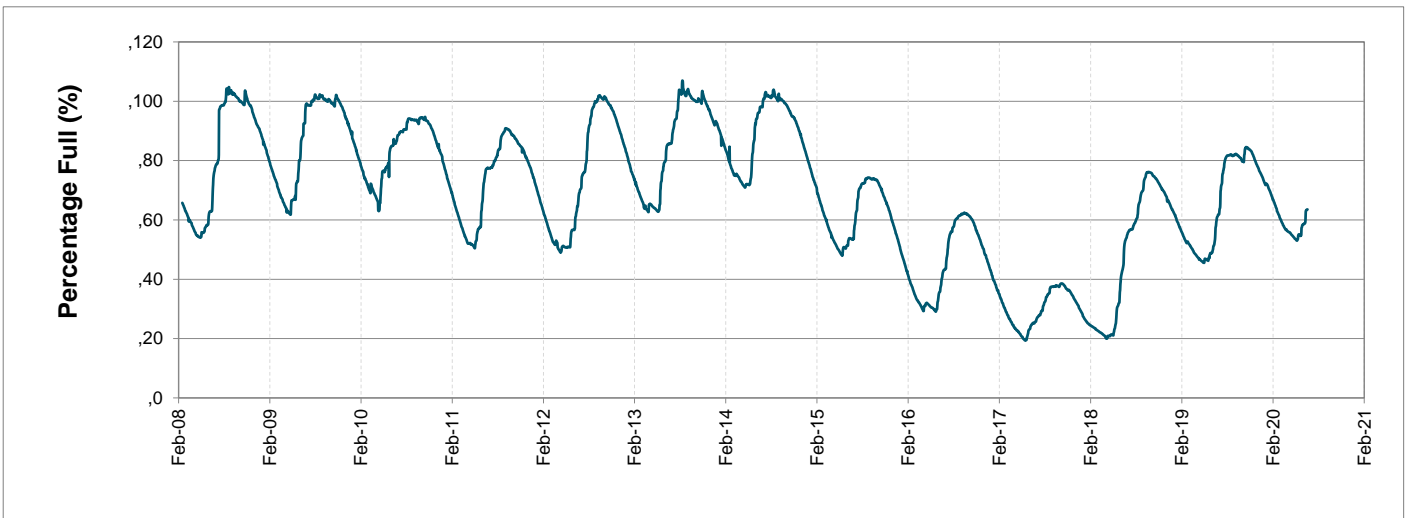

WCWSS Comparative Storage Graph (5 Years)

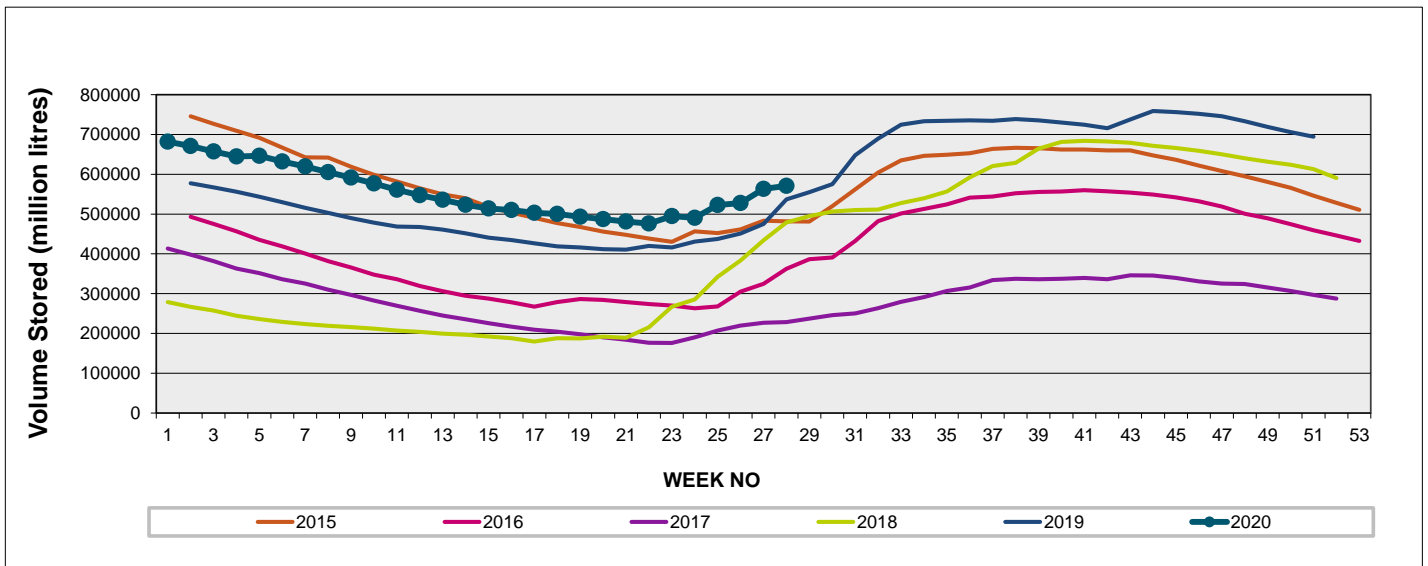

WCWSS Dam Storage and Water Use Tracking

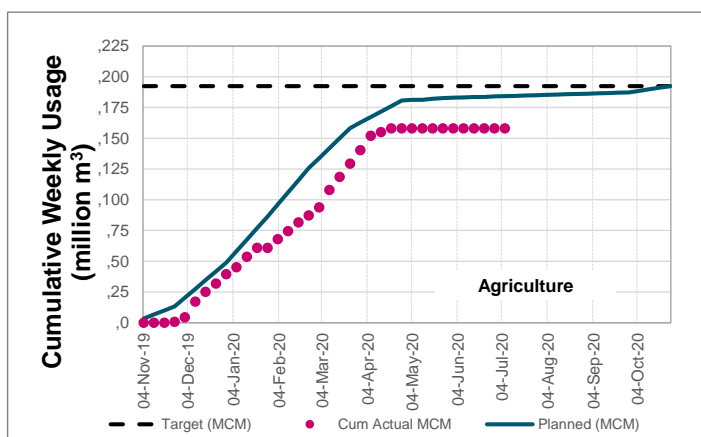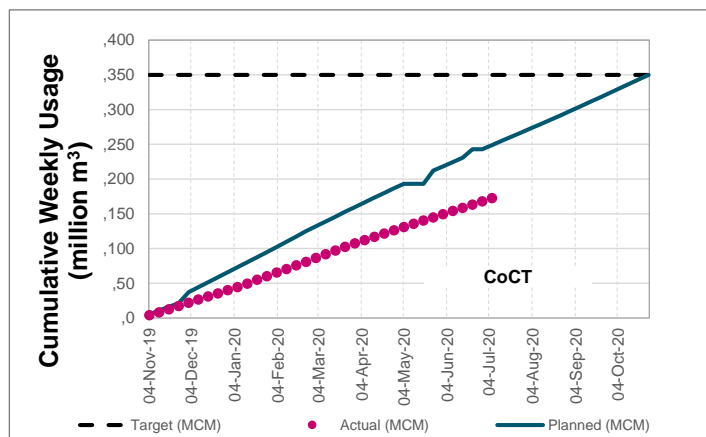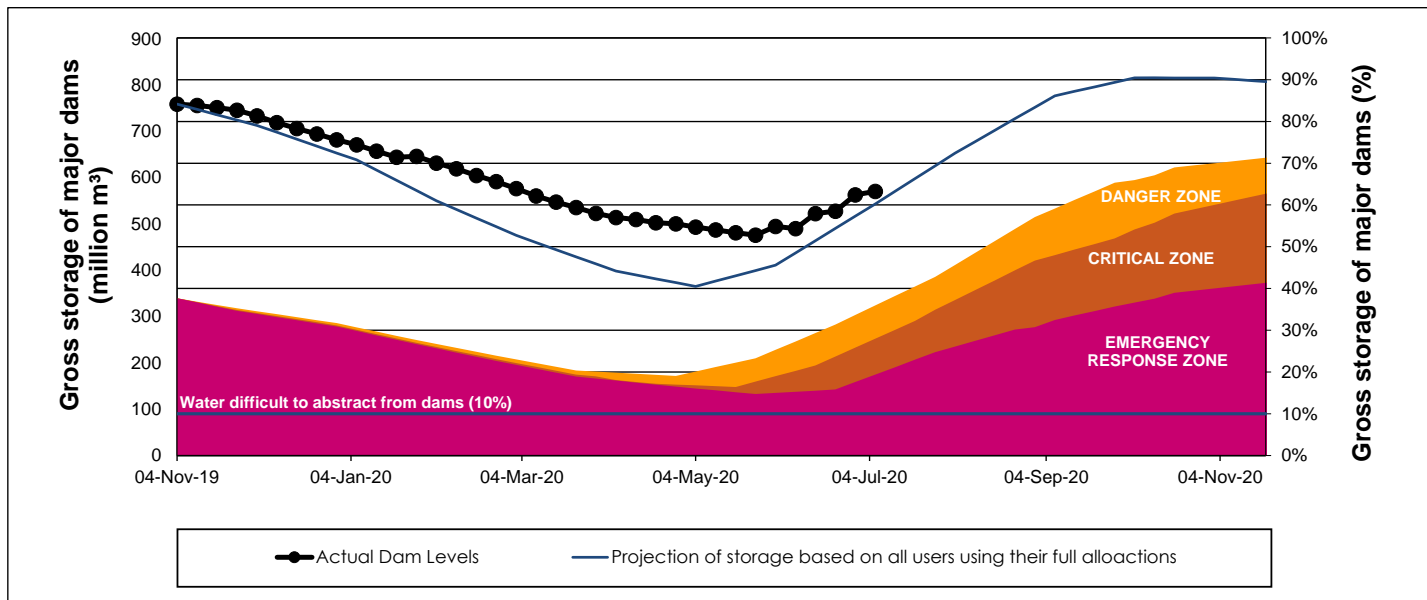

Water Stored in Minor Dams

Overall Percentage Full **74.3**

Weekly Change **4.95**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	06 July 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	59.5	50.8	22.5	95.3	44.2	35.9
DE VILLIERS (Table Mountain)	243	100.5	100.5	95.2	100.2	61.3	99.3
HELY-HUTCHINSON (Table Moun)	925	91.8	79.4	100.2	100.7	100.0	98.1
KLEINPLAATS (Simon's Town)	1 368	41.8	37.3	46.1	68.7	39.4	50.7
LAND-EN-ZEEZICHT (Helderberg)	451	71.3	70.0	86.5	97.0	66.1	28.8
LEWIS GAY (Simon's Town)	182	65.5	48.2	4.2	100.4	42.5	7.4
VICTORIA (Table Mountain)	128	100.8	102.3	60.7	95.4	101.2	37.9
WOODHEAD (Table Mountain)	954	100.3	100.3	87.9	98.9	85.9	74.8
Total Stored	4 377	3250.0	3033.6	3120.8	3889.9	2979.3	2767.4
Percentages stored		74.3	69.3	71.3	88.9	68.1	63.2


Rainfall Recorded

RAINFALL (mm)	30-Jun	01-Jul	02-Jul	03-Jul	04-Jul	05-Jul	06-Jul	Jul	
								Total*	LT Average
Blackheath Upper	1.0	0.0	1.0	0.0	0.0	0.0		1.0	78.8
Brooklands	0.0	0.0	6.0	0.0	6.0	0.0		12.0	132.9
Newlands	0.0	0.0	7.5	0.0	14.0	12.0		33.5	289.5
Steenbras	0.0	0.0	5.5	0.4	1.8	0.0		7.7	157.8
Table Mountain (Woodhead)	0.0	0.0	0.0	0.0	30.0			30.0	244.5
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.0		0.0	74.2
Tygerberg	0.0	0.0	0.0	1.5	0.0	0.0		1.5	93.3
Voëlvllei	0.0	0.0	0.2	0.0	0.0	0.0		0.2	101.1
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0		0.0	172.8
Wynberg	0.0	0.0	2.0	0.0	2.5	2.0		6.5	186.4

Notes: *Total/cummulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountaneous location

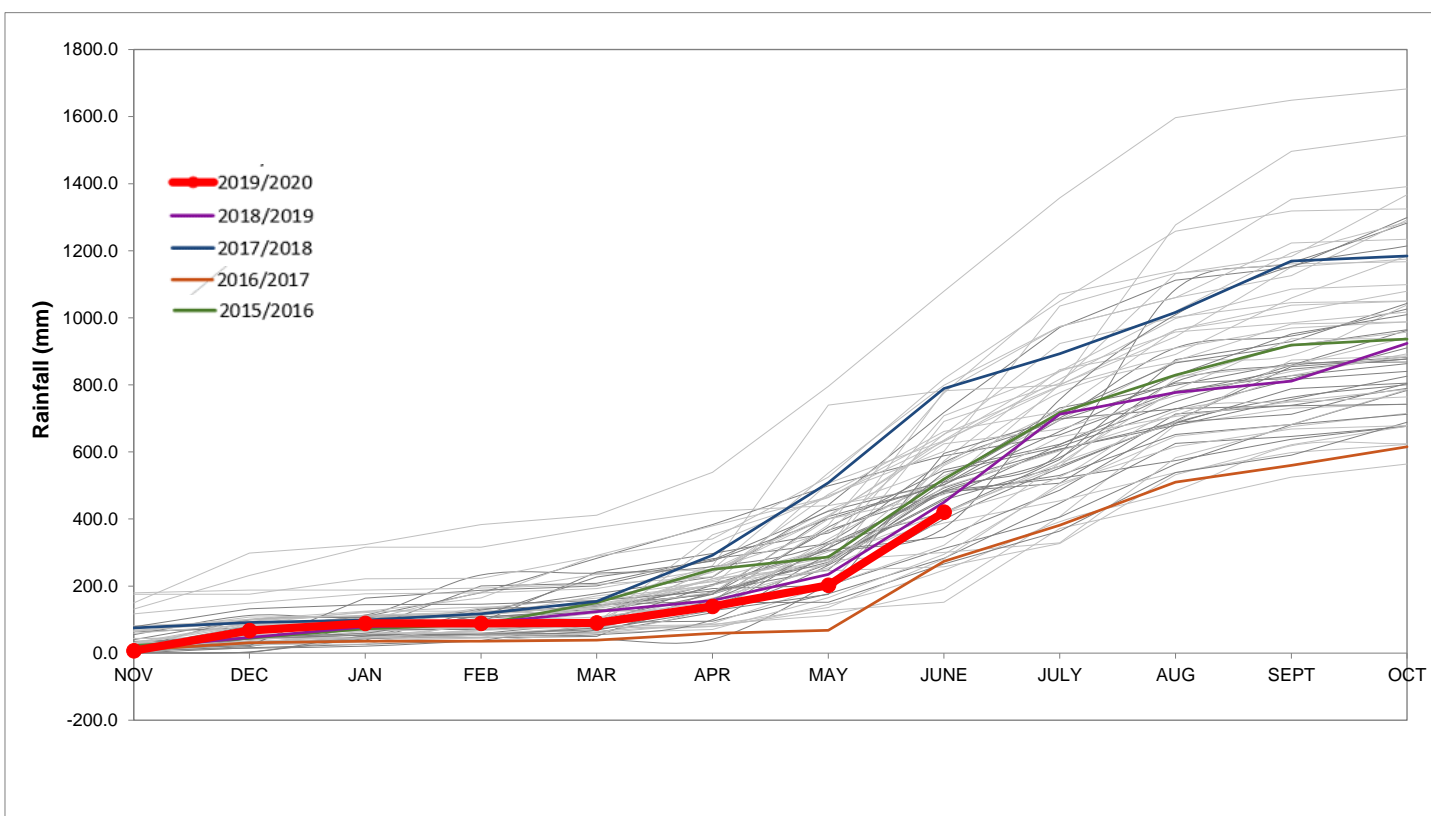

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Mar-19	99.01	98
Apr-19	99.10	98
May-19	99.08	98
Jun-19	99.09	98
Jul-19	99.04	98
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)